Stanley and Karen Pigman College of Engineering

IEEE PES T&D CONFERENCE & EXPOSITION ANAHEIM, CA 6-9 MAY 2024

IEEE PES Power & Energy Society®

Virtual Power Plant Control of Heat Pump Water Heaters and EVs on Distribution Feeders with Thousands of Residential Loads

Steven Poore, *GSMIEEE,* and Dan M. Ionel, Ph.D., *FIEEE*

SPARK Laboratory

PEIK Power and Energy Institute of Kentucky

Problem Formulation

- With rising popularity in electric vehicles (EVs), infrastructure improvements may be needed to satisfy residential energy demand
- With increasing electrification of water heating and heating ventilation and air-conditioning (HVAC), further evaluation of coordination for high power appliances may be necessary.

EV Charging and Heat Pump Water Heater Operation

- To increase energy efficiency, resistive electric water heaters (EWHs) may be replaced with heat pump water heaters (HPWHs) long-term
- Two distinct loads for HPWH: a low power heat pump compressor, and a backup high power resistive boosting element that operates when tank temperature gets too low
- Overlap of EV charging and HPWH boosting element operation may cause overload of residential transformers, especially when multiple homes with EVs are serviced by the same residential transformer.

Synthetically-Generated HPWH and EV Profiles

- A stratified node temperature model was employed to synthetically generate 145 unique and realistic HPWH power profiles using the 2019 and 2021 CBECC-Res hot water draw dataset
- Residential EV charging power profiles were generated using the California data from the 2017 National Household Travel Survey (NHTS)
- For the case study, EV charging times were determined based on vehicle arrival times and battery state-of-charge (SOC) upon arrival was calculated using distance traveled
- EV charging levels and battery capacities were assumed to be 10kW and 100kWh respectively.

Proposed VPP Control Method

- From the perspective of virtual power plant (VPP), control of temperature setpoints for appliances such as HVAC and HPWHs should be avoided, if possible, to prioritize human comfort
- For this reason, EV comes first in the priority order for shed commands in the remaining case study.

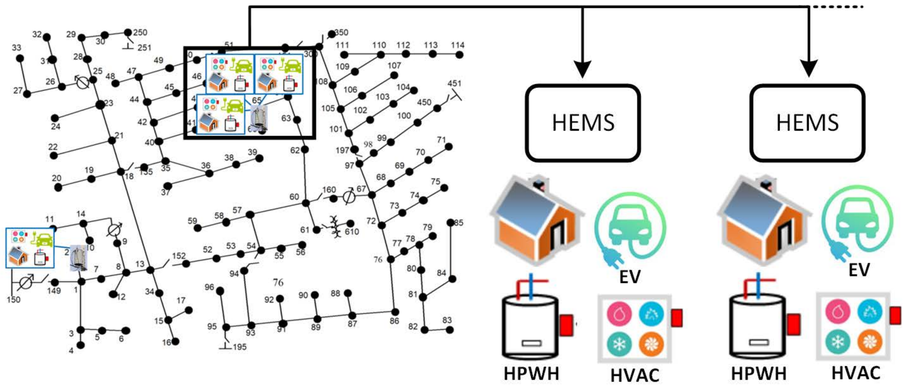

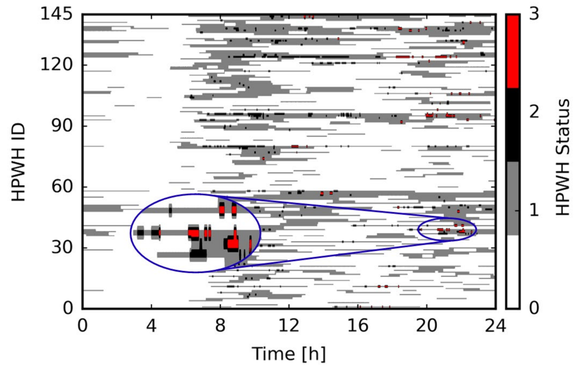

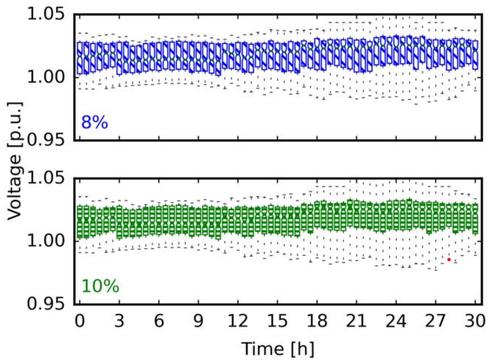

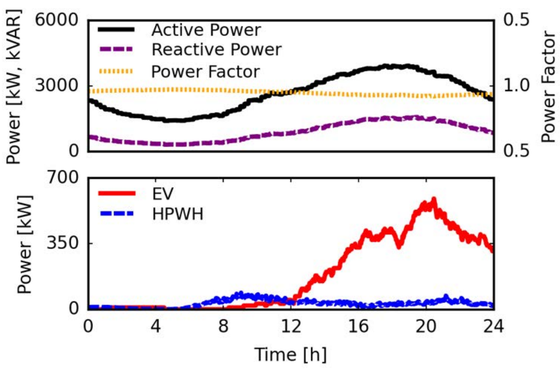

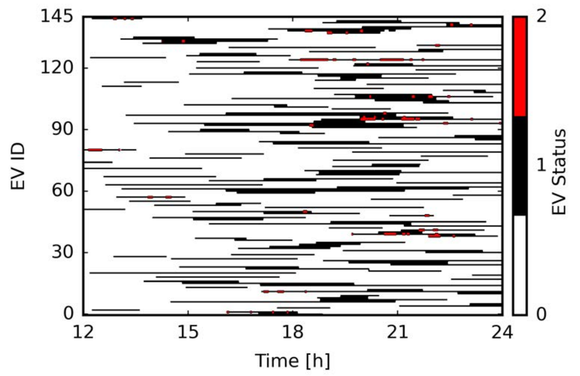

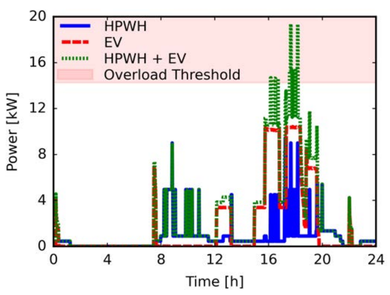

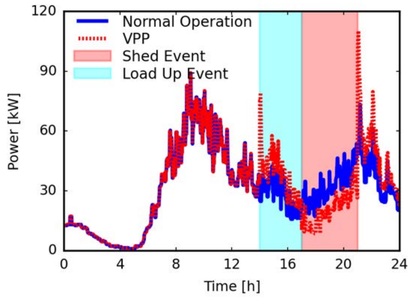

Case Study: Control of EVs to Ensure Continuous HPWH Operation

- A simulation of coordinated EV control was conducted on a modified IEEE 123-bus circuit populated with 1,765 home loads, including the 146 with CBECC-Res and NHTS-based HPWH and EV modules for a penetration rate of 8%, representing a transition case with low EV and smart appliance adoption
- The proposed VPP control method is implemented to temporarily suspend EV charging at a house if there would be simultaneous operation with its HPWH boosting element
- Residential transformers benefit more from this control method, especially during evening hours when residential demand is higher
- Most of the instances of paused EV charging happen during hours 18-24 in the day, and only for a short duration, as seen by the location and length of the red lines in the EV charging status figure.

System Voltage

- To investigate effect of EV charging on voltage, circuit simulations were implemented for different levels of EV penetration
- Voltage violations were present for penetrations of 15% and higher
- These results suggest control methods to prevent voltage violations may be necessary for distribution systems with higher EV penetration levels.

Conclusions

- Due to overlap with multiple EV charging loads with operation of high-power appliances, coordinated controls may be necessary to prevent transformer overload as EV penetration increases
- The new VPP control method was simulated on a modified IEEE 123-bus circuit populated with base home loads as well as synthetically-generated EV and HPWH loads. Impact of aggregated HPWH and EV charging load on the demand seen by the substation transformer was minimal for an 8% penetration.

Future and Ongoing Work

- Work in progress to include consideration of HVAC operation in control scheme
- Control methods to control system voltage at higher EV penetrations are in development.

Acknowledgement

This work is supported by the National Science Foundation (NSF) under NSF Graduate Research Fellowship Grant No. 2239063. Any opinions, findings, conclusions, or recommendations expressed in this material are those of the authors and do not necessarily reflect the views of NSF. Special thanks are due to the industry collaborators from AO Smith Corporation.